


NOTES:

- 1. TRENCH WIDTH "W" SHALL BE 40" MINIMUM FOR 15" DIAMETER AND SMALLER PIPES AND 1 1/2 TIMES THE INSIDE DIAMETER PLUS 18" MINIMUM FOR 18" AND LARGER PIPES.
- 2. 5/8" CRUSHED SURFACING TOP COURSE BACKFILL MATERIAL REQUIRED ON SMALL TRENCH REPAIR UTILITY PROJECTS, UNLESS DIRECTED OTHERWISE BY THE ENGINEER. FOR CITY OF RICHLAND CAPITAL IMPROVEMENT PROJECTS AND SUBDIVISIONS SECTION 7-08 OF THE WSDOT STANDARD SPECIFICATIONS SHALL APPLY.
- 3. HMA PATCH LIMITS SHALL MEET THE REQUIREMENTS OF RICHLAND MUNICIPAL CODE 12.08.065. MINIMUM 6 FT WIDE.



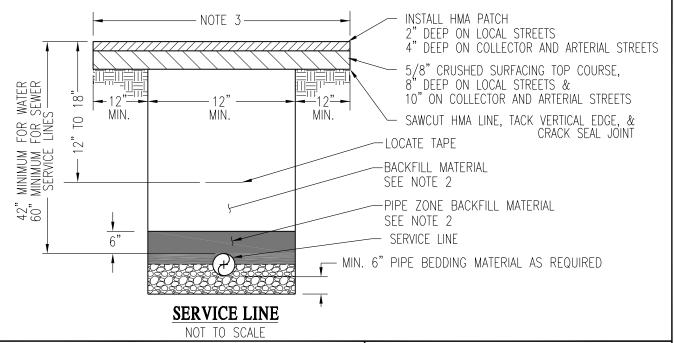

TRENCH DETAIL

PUBLIC WORKS ENGINEERING	
APPR. BY: SAW	DATE: 01.24
DRAWN BY: JLR	DWG: U2
CAD FILE: 2014_U2_01_2024	